SIEMENS

Data sheet

3RA2317-8XB30-1FB4



Reversing contactor assembly AC-3, 5.5 kW/400 V, 24 V DC 3-pole, Size S00 screw terminal electrical and mechanical interlock with integrated diode


| product brand name | SIRIUS | | | |
|--|------------------------------|--|--|--|
| product designation | Reversing contactor assembly | | | |
| product type designation | 3RA23 | | | |
| manufacturer's article number | | | | |
| 1 of the supplied contactor | 3RT2017-1FB42 | | | |
| • 2 of the supplied contactor | 3RT2017-1FB42 | | | |
| of the supplied RH assembly kit | <u>3RA2913-2AA1</u> | | | |
| General technical data | | | | |
| size of contactor | S00 | | | |
| product extension auxiliary switch | Yes | | | |
| shock resistance at rectangular impulse | | | | |
| • at AC | 7,3g / 5 ms, 4,7g / 10 ms | | | |
| • at DC | 7.3g / 5 ms, 4.7g / 10 ms | | | |
| shock resistance with sine pulse | | | | |
| • at AC | 11,4g / 5 ms, 7,3g / 10 ms | | | |
| • at DC | 11,4g / 5 ms, 7,3g / 10 ms | | | |
| mechanical service life (switching cycles) | | | | |
| of contactor typical | 10 000 000 | | | |
| of the contactor with added auxiliary switch block | 10 000 000 | | | |
| typical | | | | |
| reference code according to IEC 81346-2 | Q | | | |
| Substance Prohibitance (Date) | 10/01/2009 | | | |
| Ambient conditions | | | | |
| installation altitude at height above sea level maximum | 2 000 m | | | |
| ambient temperature | | | | |
| during operation | -25 +60 °C | | | |
| during storage | -55 +80 °C | | | |
| Main circuit | | | | |
| number of poles for main current circuit | 3 | | | |
| number of NO contacts for main contacts | 3 | | | |
| number of NC contacts for main contacts | 0 | | | |
| operating voltage at AC-3 rated value maximum | 690 V | | | |
| operational current at AC-3 | | | | |
| • at 400 V rated value | 12 A | | | |
| • at 500 V rated value | 9.2 A | | | |
| • at 690 V rated value | 6.7 A | | | |
| operating power | | | | |
| • at AC-3 | | | | |
| — at 400 V rated value | 5.5 kW | | | |


| — at 500 V rated value | 5.5 kW |
|---|---|
| — at 690 V rated value | 5.5 kW |
| • at AC-4 at 400 V rated value | 4 kW |
| operating frequency at AC-3 maximum | 750 1/h |
| | 750 1/11 |
| Control circuit/ Control | 20 |
| type of voltage of the control supply voltage | DC |
| control supply voltage 1 | |
| at DC rated value | 24 V |
| design of the surge suppressor | diode |
| closing power of magnet coil at DC | 4 W |
| holding power of magnet coil at DC | 4 W |
| Auxiliary circuit | |
| contact reliability of auxiliary contacts | < 1 error per 100 million operating cycles |
| UL/CSA ratings | |
| full-load current (FLA) for 3-phase AC motor | |
| at 480 V rated value | 11 A |
| at 600 V rated value | 11 A |
| yielded mechanical performance [hp] for 3-phase AC motor | |
| at 200/208 V rated value | 1.5 hp |
| • at 220/230 V rated value | 3 hp |
| • at 460/480 V rated value | 7.5 hp |
| • at 575/600 V rated value | 10 hp |
| contact rating of auxiliary contacts according to UL | A600 / Q600 |
| Short-circuit protection | 10001 0000 |
| design of the fuse link | |
| for short-circuit protection of the main circuit | |
| - with type of coordination 1 required | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 50 A |
| — with type of assignment 2 required | gG NH 3NA, DIAZED 5SB, NEOZED 5SE: 35 A |
| for short-circuit protection of the auxiliary switch | fuse gG: 10 A |
| required | luse go. To A |
| . equiled | |
| Installation/ mounting/ dimensions | |
| | +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface |
| Installation/ mounting/ dimensions | |
| Installation/ mounting/ dimensions mounting position | forward and backward by +/- 22.5° on vertical mounting surface |
| Installation/ mounting/ dimensions mounting position fastening method | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail |
| Installation/ mounting/ dimensions mounting position fastening method height | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 0 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 0 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side • for grounded parts | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side • for grounded parts — forwards — backwards — upwards — upwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side • for grounded parts — forwards — backwards — at the side | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 0 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side • for grounded parts — forwards — backwards — upwards — upwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side • for grounded parts — forwards — backwards — at the side • at the side — backwards — at the side — backwards — at the side | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side • for grounded parts — forwards — backwards — at the side • downwards — upwards — at the side — downwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side • for grounded parts — forwards — backwards — at the side • for grounded parts — forwards — backwards — upwards — upwards — at the side — downwards — at the side — downwards — at the side — odownwards — odownwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side • for grounded parts — forwards — backwards — backwards — backwards — at the side • for grounded parts — forwards — backwards — upwards — at the side — downwards — at the side — downwards — at the side — downwards — at the side — for live parts — forwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side • for grounded parts — forwards — backwards — backwards — upwards — at the side • for grounded parts — forwards — backwards — upwards — backwards — of the side — downwards — at the side — downwards — at the side — downwards — backwards — backwards — backwards — backwards — backwards — backwards — backwards — backwards — backwards — backwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side • for grounded parts — forwards — backwards — backwards — upwards — at the side — downwards — at the side — downwards — at the side — downwards — at the side — downwards — backwards — upwards — at the side — downwards • for live parts — forwards — backwards — upwards — upwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — at the side • for grounded parts — forwards — backwards — upwards — at the side — downwards — at the side — downwards — at the side — downwards — at the side — downwards — at the side — downwards • for live parts — forwards — backwards — upwards — upwards — downwards • for live parts — forwards — backwards — upwards — backwards — upwards — downwards — backwards — upwards — backwards — upwards — backwards — backwards | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — backwards — upwards — a the side • for grounded parts — forwards — backwards — backwards — upwards — at the side — downwards — for live parts — forwards • for live parts — forwards — backwards — upwards — at the side — downwards • for live parts — forwards — backwards — upwards — downwards — backwards — at the side — downwards — at the side — downwards — at the side | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |
| Installation/ mounting/ dimensions mounting position fastening method height width depth required spacing • with side-by-side mounting — forwards — backwards — upwards — downwards — a the side • for grounded parts — forwards — backwards — backwards — upwards — at the side — downwards — at the side — downwards • for live parts — forwards — backwards — upwards — at the side — downwards • for live parts — forwards — backwards — upwards — at the side — downwards — backwards — upwards — at the side — downwards — at the side | forward and backward by +/- 22.5° on vertical mounting surface screw and snap-on mounting onto 35 mm standard mounting rail 68 mm 90 mm 73 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm 6 mm |


| for auxiliary and | l control circuit | | screw-type terminals | | |
|--|--|---|---|--|--------------------------------|
| at contactor for auxiliary contacts of magnet coil | | Screw-type terminals | | | |
| of magnet coil | | | Screw-type terminals | | |
| type of connectable | conductor cross-sect | tions | | | |
| for main contact | ts | | | | |
| — solid | | | 2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²), 2x 4 mm² | | |
| — solid or stra | anded | | 2x (0,5 1,5 mm²), 2x (0,75 2,5 mm²), 2x (0,5 4 mm²) | | |
| finely stran | ided with core end proc | cessing | 2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²) | | |
| at AWG cables | for main contacts | | 2x (20 16), 2x (18 14) | | |
| type of connectable | conductor cross-sect | tions | | | |
| for auxiliary con | tacts | | | | |
| — solid or stranded | | | 2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²) | | |
| finely stranded with core end processing | | 2x (0.5 1.5 mm ²), 2x (0.75 2.5 mm ²) | | | |
| at AWG cables for auxiliary contacts | | 2x (20 16), 2x (18 14) | | | |
| Safety related data | | | | | |
| B10 value with high demand rate according to SN 31920 | | | 1 000 000 | | |
| proportion of dange | | | | | |
| | d rate according to SN | 31920 | 40 % | | |
| | nd rate according to SN | | 75 % | | |
| - | ow demand rate accord | | 100 FIT | | |
| 31920 | | | | | |
| IEC 61508 | t interval or service life | | 20 y | | |
| 60529 | on the front according | | IP20 | | |
| touch protection on | the front according to | DIEC 60529 | finger-safe, for vertical con | tact from the front | |
| Communication/ Prote | ocol | | | | |
| product function bus | s communication | | Yes | | |
| protocol is supported | AS-Interface protocol | | No | | |
| product function contr | ol circuit interface with | IO link | No | | |
| Certificates/ approvals | S | | | | |
| General Product Approval | | | | | |
| General Product Ap | proval | | | Declaration of Confo | ormity |
| General Product Ap | proval | Ē | rnr | Declaration of Confo | |
| General Product Ap | | Ŵ | EAC | Declaration of Confo | UK |
| SÞ | | (ال س | EAC | CE | UKCA |
| SÞ | | UL UL | FRE | CE | UK |
| CSA Test Certificates | <u>Confirmation</u> | | ping | CE | UK |
| SP. | | | ping | CE | UK CA |
| Test Certificates Special Test Certific- | <u>Confirmation</u> | | ERC ping | CE | UK CA Lloyds Register |
| Test Certificates Special Test Certific- | <u>Confirmation</u> | | ping | CE | |
| Test Certificates Special Test Certific- | <u>Confirmation</u> | | ping UREAU VERITAS | EG-Konf. | UK CA |
| Test Certificates Special Test Certific- | <u>Confirmation</u> | | Pping | EG-Konf. | UK CA |
| Test Certificates Special Test Certific- ate | <u>Confirmation</u> | | BUREAU VERITAS | EG-Konf. | UK CA |
| Test Certificates Special Test Certific- | <u>Confirmation</u> | | ping other | EG-Konf. | UK CA |
| Test Certificates Special Test Certific- ate | <u>Confirmation</u> | | BUREAU VERITAS | EG-Konf. | UK CA |
| Test Certificates Special Test Certific- ate | <u>Confirmation</u> | | BUREAU VERITAS | EG-Konf. | UK CA |
| Test Certificates Special Test Certific- ate | <u>Confirmation</u> | | BUREAU VERITAS | EG-Konf. | UK CA |
| Test Certificates Special Test Certific- ate | <u>Confirmation</u> | | BUREAU VERITAS | EG-Konf. | UK CA |
| Test Certificates Special Test Certific- ate | <u>Confirmation</u> | | BUREAU VERITAS | EG-Konf. | UK CA |
| Test Certificates Special Test Certific- ate | <u>Confirmation</u> | | BUREAU VERITAS | EG-Konf. | UK CA |
| Test Certificates Special Test Certific- ate | <u>Confirmation</u> | | BUREAU VERITAS | EG-Konf. | UK CA |
| Test Certificates Special Test Certificates Special Test Certificates Marine / Shipping Warine / Shipping Further information | Confirmation Confi | Marine / Ship | other Confirmation | EG-Konf. | UK CA |
| Test Certificates Special Test Certificates Special Test Certificates Marine / Shipping Warine / Shipping Further information | Confirmation Type Test Certific- ates/Test Report | Marine / Ship | other Confirmation | EG-Konf. | UK CA |
| Test Certificates Special Test Certificates Special Test Certificates Marine / Shipping Marine / Shipping Eurther information Information- and Dom https://www.siemens.org/industry Mall (Online) | Confirmation Confirmation Type Test Certific- ates/Test Report | Marine / Ship | other Confirmation | Cont. Cont. Cont | UK CA |
| Test Certificates Special Test Certificates Special Test Certificates Marine / Shipping Marine / Shipping Eurther information Information- and Down https://www.siemens.org Industry Mall (Online https://mall.industry.si | Confirmation Confirmation Type Test Certific- ates/Test Report | Marine / Ship | other Confirmation | Cont. Cont. Cont | UK CA |
| Test Certificates Special Test Certificates Special Test Certificates Marine / Shipping Marine / Shipping Eurther information Information- and Down https://www.siemens.org Industry Mall (Online https://mall.industry.sii Cax online generator | Confirmation Confirmation Type Test Certific- ates/Test Report | Marine / Ship | other Confirmation | EG-Konf. | UK CA |

Service&Support (Manuals, Certificates, Characteristics, FAQs,...) https://support.industry.siemens.com/cs/ww/en/ps/3RA2317-8XB30-1FB4 Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RA2317-8XB30-1FB4&lang=en Characteristic: Tripping characteristics, I²t, Let-through current https://support.industry.siemens.com/cs/ww/en/ps/3RA2317-8XB30-1FB4/char

Further characteristics (e.g. electrical endurance, switching frequency) http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RA2317-8XB30-1FB4&objecttype=14&gridview=view1

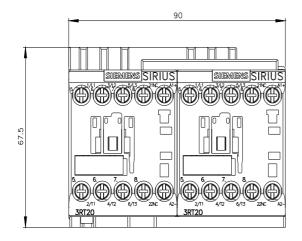



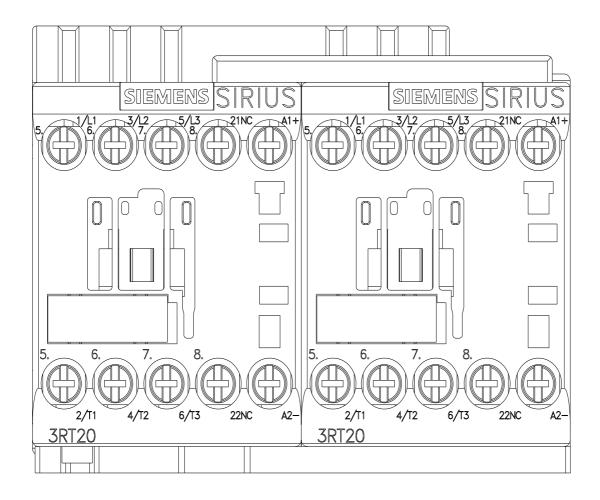

last modified:

2/8/2022 🖸